



26 Daisy Street
Revesby NSW 2212

P 02 9772 2088

E sales@japanceramics.com.au

japanceramics.com.au

CRAFTART

TILE WHOLESALERS SINCE 1975

COLOURS

Plain - (9 faces)



Cotto Desert Earth Ice

3D Ringlet - (9 faces)



Cotto Desert Earth Ice

Leaf - (4 faces)



Cotto Desert Earth Ice

FORMATS



200 x 200mm



75 x 230mm

FINISH: **MATT** | CATEGORY: GLAZED FLOOR TILE | EDGE DETAIL: RECTIFIED | V RATING: V2




CRAFTART

The Craftart Range is a versatile and stylish porcelain tile collection available in 75x230mm subway format (Plain) and 200x200mm, offering a blend of timeless elegance and contemporary design. Available in four distinct colours, Cotto, Earth, Desert, and Ice. This range provides a warm and sophisticated palette suitable for various interior styles. Craftart features a diverse selection of patterns, including Plain, 3D Ringlet, and Leaf, allowing for creative and dynamic installations. Whether used for feature walls, splashbacks, or flooring, this collection combines texture, depth, and durability.





COTTO

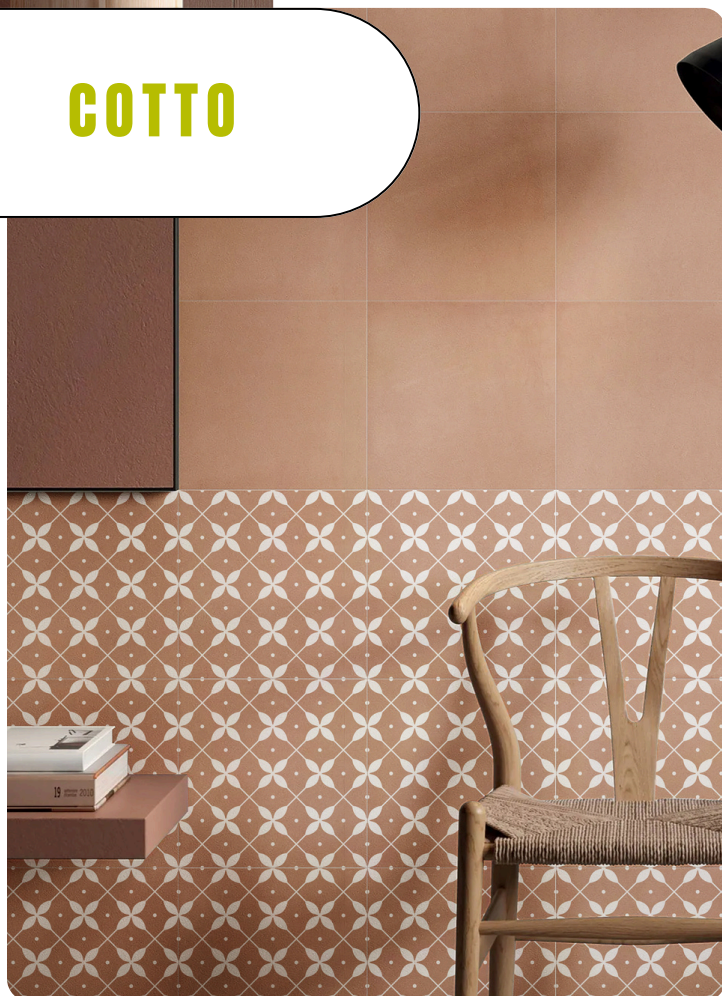



DESERT





EARTH





ICE





26 Daisy Street
Revesby NSW 2212
P 02 9772 2088
E sales@japanceramics.com.au
japanceramics.com.au

TILE WHOLESALERS SINCE 1975

Slip Resistance Disclaimer:

The slip resistance rating provided is an indicative result only, determined from testing a specific batch. The tiles you receive may differ in batch, and their slip resistance may vary. Japan Ceramics Pty Ltd accepts no liability if the supplied tiles do not achieve the stated result. It remains the responsibility of the end user to ensure the tiles are tested and deemed suitable for their intended application.

Slip Check to AS 4586-2013

Craftart 200x200

Report Number: R34074a**Report Date: 7 July 2025****Total Number of Pages 2**

Safe Environments quality management system is certified to ISO 9001:2015

Accredited for compliance with ISO/IEC 17025 – Testing

NATA is a signatory to the ILAC Mutual Recognition Arrangement for the mutual recognition of the equivalence of testing, medical testing, calibration, inspection, proficiency testing scheme providers and reference materials producers reports and certificates

Issued by

Safe Environments Pty Limited
6/7 Inglewood Place
Norwest NSW 2153

Prepared for

Japan Ceramics Pty Ltd
26 Daisy Street
Revesby NSW 2212

Approved by
Ratan Venkatesan
Authorised Signatory

7 July 2025

Test Report No. R34074a

Slip Resistance Classification of New Pedestrian Surface Materials

AS 4586-2013 Appendix A (Wet Pendulum Test)

The slip resistance classification has been determined for unused surfaces under specific conditions. Factors such as usage, cleaning systems, applied coatings and patterns of wear may affect the characteristics of the surface after classification. Standards Australia Handbook 198:2014 *Guide to the specification and testing of slip resistance of pedestrian surfaces* provides guidance for the selection of slip resistant pedestrian surfaces classified in accordance with AS 4586-2013. It is recommended that this test report be read in conjunction with AS 4586, HB 197 & HB 198.

Requested by: Japan Ceramics Pty Ltd
Client Address: 26 Daisy Street
Revesby NSW 2212
Product Manufacturer: Max Glory
Product Description: Craftart 200x200

Test conducted according to: AS 4586:2013 Appendix A
Sampling Procedures: Performed by client and tested as received.
Location: 6/7 Inglewood Place, Norwest NSW 2153

Conducted by: Ratan Venkatesan

Date:	07 July 2025	Temperature:	17°C
Sample:	Unfixed	Cleaning:	None
Rubber slider used:	Slider 96	Conditioned:	Grade P 400 paper dry followed by wet lapping film
Slope of specimen:	Tested on a flat level surface		
Direction of Test:	N/A		

	Specimen 1	Specimen 2	Specimen 3	Specimen 4	Specimen 5
Mean BPN of last 3 swings:	37	40	35	37	40

Reported SRV of Sample:	38
Class:	P3

The expanded uncertainty (U_{95}) at the 95% level of confidence with a coverage factor (k) of 2 has been estimated to be 3 BPN or 8 %, whichever is the greater; sampling uncertainty has not been included. The expanded uncertainty should be considered when interpreting results or assessing conformity. Results relate only to items tested.